

○ - Carbon Monoxide Detector

● - Smoke Detector

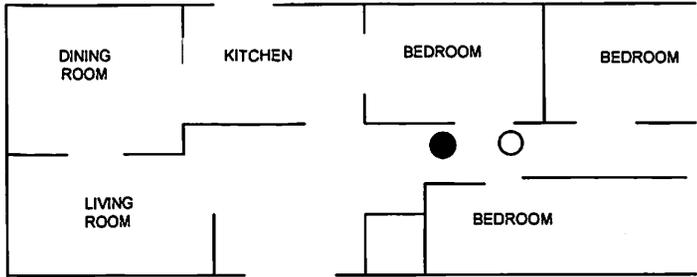


Figure 1
In homes with only one sleeping area on one floor, the smoke and CO detector are to be put in the hallway outside the bedrooms.

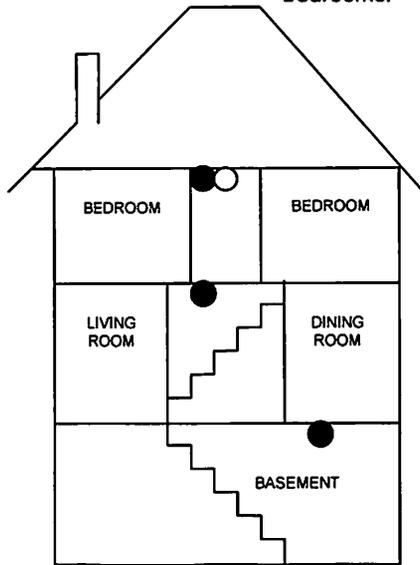


Figure 3
In multi-level homes, smoke detectors shall be located outside sleeping areas and at every finished level of the home. CO detectors are required for every sleeping area.

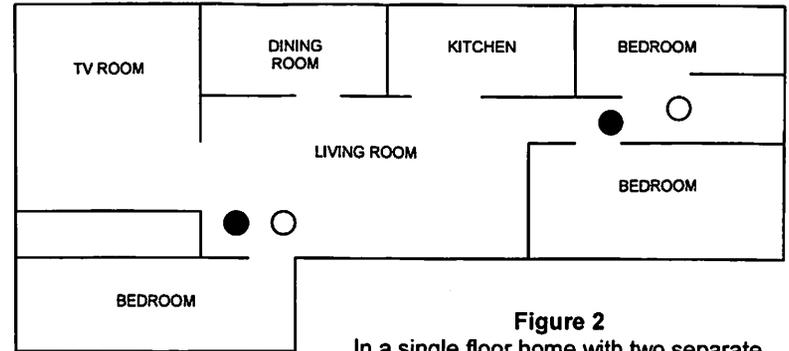


Figure 2
In a single floor home with two separate sleeping areas, two smoke and CO detectors are required, one of each outside each sleeping area.

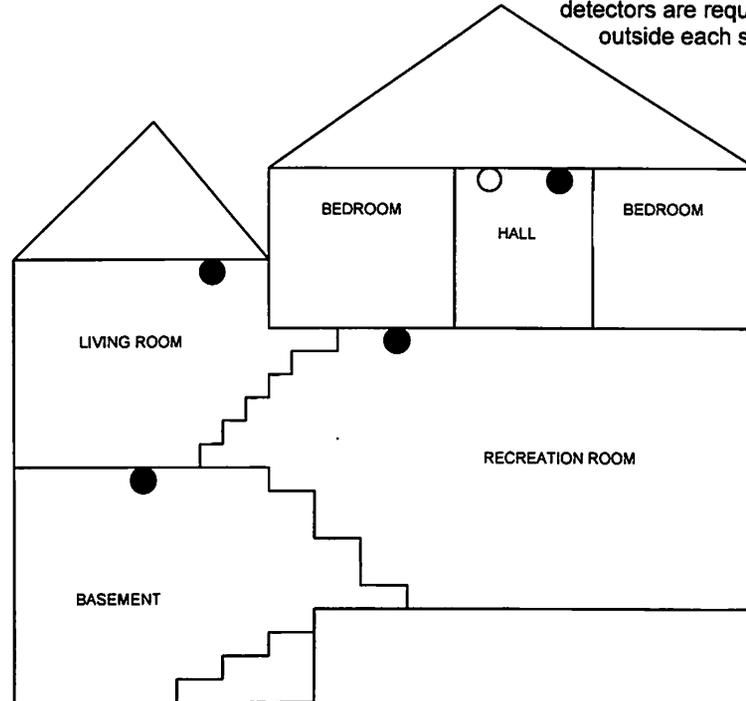


Figure 4
Basement level smoke detectors shall be located at the bottom of basement stairwell, ceiling mounted. CO detectors are required for every sleeping level.